


\\jerome\01\DeptEngineering\Shared\CAD_STANDARDS\Ver2018\Section300-Trenching\SD-301-TypicalTrench-C3D2018.dwg

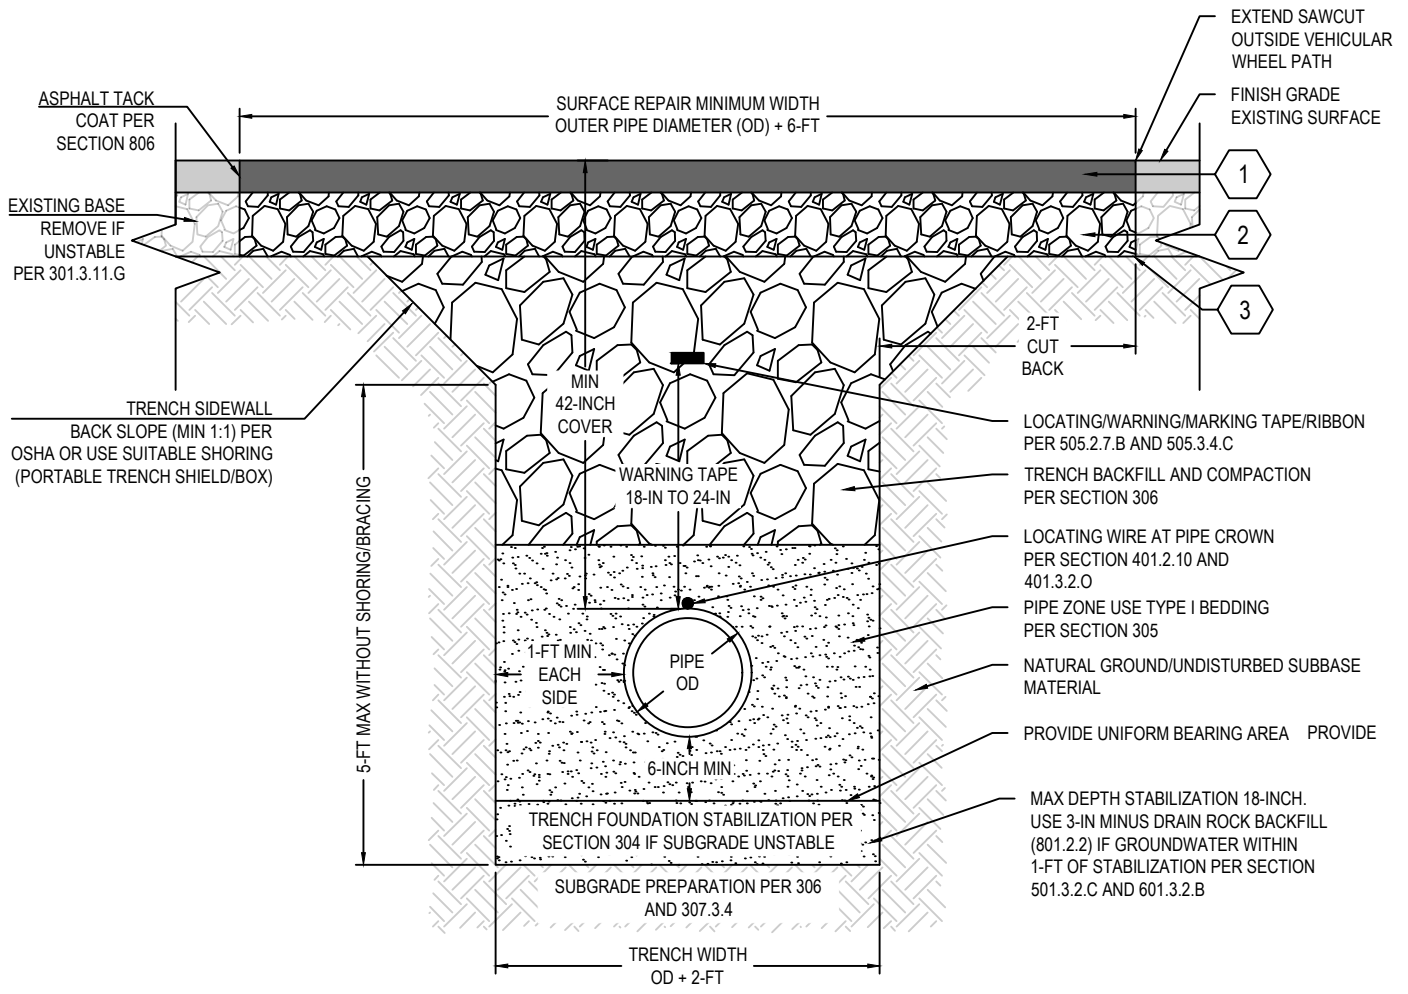

A **TYPICAL TRENCH DETAIL**

Relative Scale 1"=1.5' 0' 0.75' 1.5'

Absolute Scale 1:18

ISPCW SPECIFICATION REFERENCE	GENERAL NOTES	SHEET KEYNOTES
DIV 300 TRENCHING SEC 307 STREET CUTS AND SURFACE REPAIRS HMA HOT-MIX ASPHALT OSHA OCCUPATIONAL SAFETY AND HEALTH - SLOPING AND BENCHING (1926 Subpart P App B) ISPCW IDAHO STANDARDS FOR PUBLIC WORKS CONSTRUCTION	A INSPECTION REQUIRED BEFORE BACKFILLING B 6" MIN BEDDING MATERIAL (3/8" REJECT SAND) C TRENCH DIMENSIONS PER ISPCW 301.3.12 D ALLOW ENGINEER TWO WORKING DAYS TO MEASURE PIPE LOCATION PER SECTION 401.3.8.B E INSPECTION REQUIRED BEFORE BACKFILLING	X SHEET KEYNOTES 1 HMA THICKNESS MIN. 3-IN OR MATCH EXIST WHICHEVER GREATER. 2 AGGREGATE BASE MIN. 6-IN OR MATCH EXIST WHICHEVER GREATER. 3 SUBBASE MAY BE REQUIRED

 <p>CITY OF JEROME PUBLIC WORKS Richard Wuori, PE, Director 152 East Avenue A Jerome ID 83338 http://www.ci.jerome.id.us</p>	<h1>TYPICAL TRENCH</h1>	<p>STANDARD DRAWING NO.</p> <h1>SD-301</h1> <p>DATE 21 SEPT 2017</p>
--	-------------------------	--